


# A-Frame 202509

## Thermal protection

$U = 0,11 \text{ W}/(\text{m}^2\text{K})$

DIN 4108\*:  $R > 1,76 \text{ m}^2\text{K}/\text{W} + R_{\text{si}} + R_{\text{se}}$





## Moisture proofing

Drying reserve: 1018 g/m<sup>2</sup>a  
No condensate



## Heat protection

Temperature amplitude damping: 80  
phase shift: 16,2 h  
Thermal capacity inside: 54 kJ/m<sup>2</sup>K

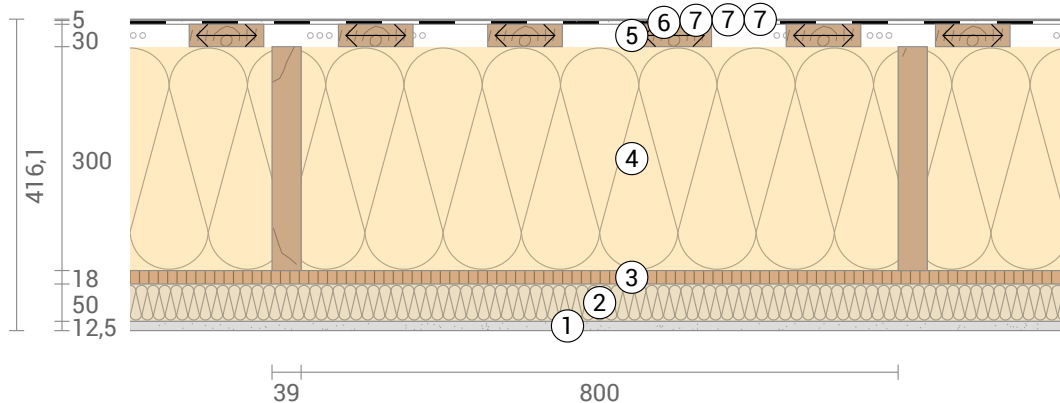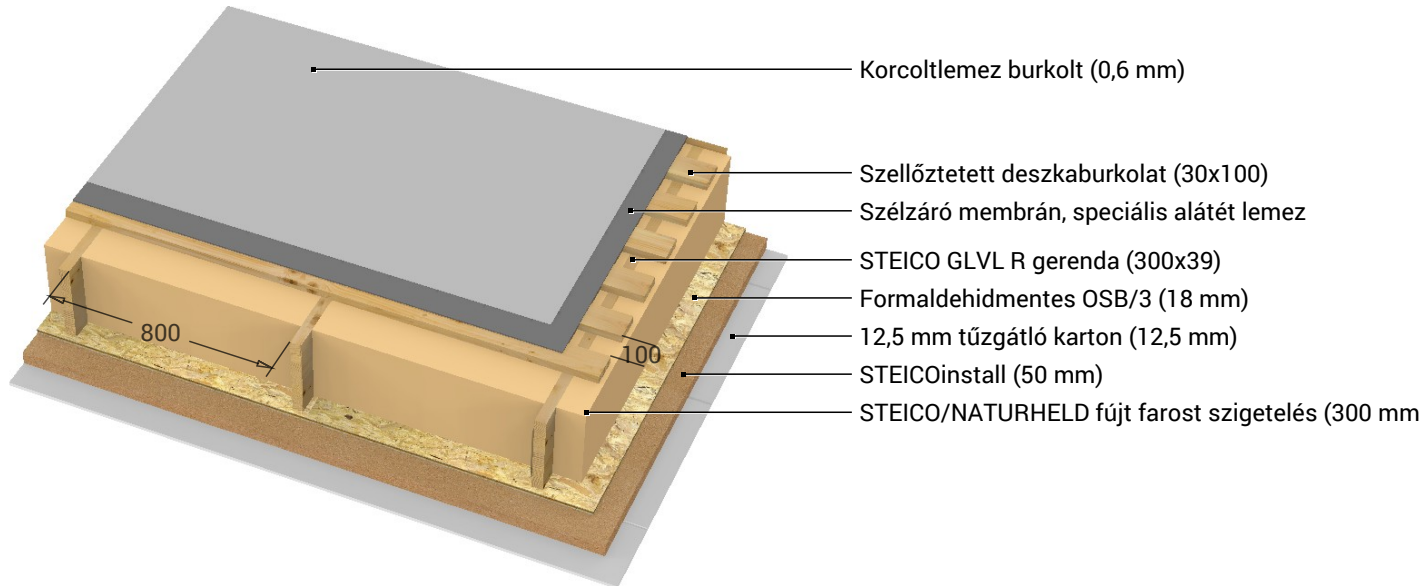

- |                                                    |                                            |
|----------------------------------------------------|--------------------------------------------|
| ① 12,5 mm tűzgátló karton (12,5 mm)                | ⑥ Szélzáró membrán, speciális alátét lemez |
| ② STEICOinstall (50 mm)                            | ⑦ Korcoltlemez burkolt (0,6 mm)            |
| ③ Formaldehidmentes OSB/3 (18 mm)                  |                                            |
| ④ STEICO/NATURHELD fűjt farost szigetelés (300 mm) |                                            |
| ⑤ 30 mm légréssel (30 mm)                          |                                            |

<-> Layers marked by arrows are perpendicular to the main axis.

Inside air : 22,0°C / 50%  
Outside air: -5,0°C / 70%  
Surface temperature.: 21,1°C / -4,9°C

sd-value: 5,2 m

Thickness: 41,6 cm  
Weight: 62 kg/m<sup>2</sup>  
Heat capacity: 80 kJ/m<sup>2</sup>K

☒ BEG Einzelmaßn. ☒ GEG 2020/24 Bestand ☒ GEG 2023/24 Neubau ☒ DIN 4108

A-Frame 202509,  $U=0,11 \text{ W}/(\text{m}^2\text{K})$ 

## U-Value calculation according to DIN EN ISO 6946

| # | Material                                 | Dicke<br>[cm] | $\lambda$<br>[W/mK] | R<br>[m <sup>2</sup> K/W] |
|---|------------------------------------------|---------------|---------------------|---------------------------|
|   | Thermal contact resistance inside (Rsi)  |               |                     | 0,100                     |
| 1 | 12,5 mm tűzgátló karton                  | 1,25          | 0,250               | 0,050                     |
| 2 | STEICOinstall                            | 5,00          | 0,040               | 1,250                     |
| 3 | Formaldehydmentes OSB/3                  | 1,80          | 0,130               | 0,138                     |
| 4 | STEICO/NATURHELD fűtő farost szigetelés  | 30,00         | 0,038               | 7,895                     |
|   | STEICO GLVL R gerenda (4,6%)             | 30,00         | 0,130               | 2,308                     |
|   | Thermal contact resistance outside (Rse) |               |                     | 0,100                     |

Thermal contact resistances have been taken from DIN 6946 Table 7.

Rsi: heat flow direction upwards

Rse: heat flow direction upwards, outside: Ventilation level

Upper limit of thermal resistance  $R_{\text{tot;upper}} = 8,945 \text{ m}^2\text{K/W}$ .

Lower limit of thermal resistance  $R_{\text{tot;lower}} = 8,735 \text{ m}^2\text{K/W}$ .


Check applicability:  $R_{\text{tot;upper}} / R_{\text{tot;lower}} = 1,024$  (maximum allowed: 1,5)

The procedure may be used.

Thermal resistance  $R_{\text{tot}} = (R_{\text{tot;upper}} + R_{\text{tot;lower}})/2 = 8,840 \text{ m}^2\text{K/W}$

Estimated maximum relative uncertainty according to section 6.7.2.5: 1,2%

Heat transfer coefficient  $U = 1/R_{\text{tot}} = 0,11 \text{ W}/(\text{m}^2\text{K})$

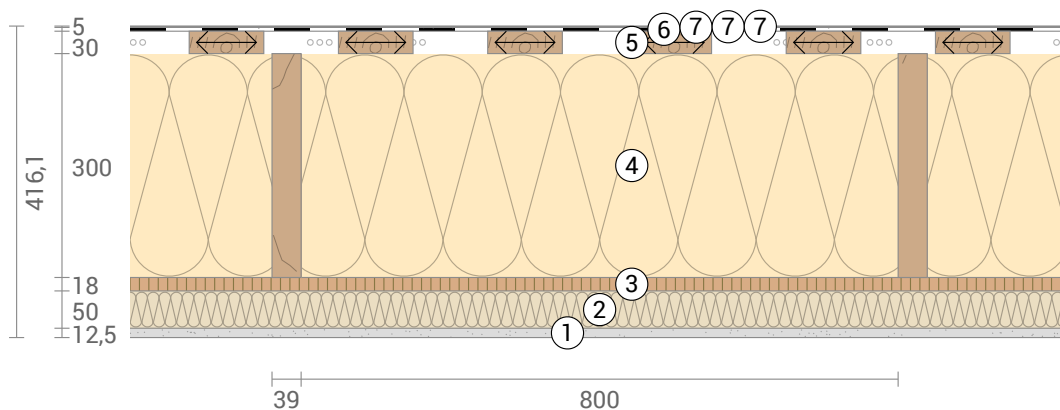

A-Frame 202509, U=0,11 W/(m²K)

## LCA

Heat loss: 11 kWh/m² per heating season



Amount of heat that escapes through one square meter of this component during the heating period. Please note: Due to internal and solar gains, the heating demand is lower than the heat loss.

Primary energy (non renewable): &gt;238 kWh/m²




Non-renewable primary energy (= energy from fossil fuels and nuclear energy) that was used to produce the new building materials ("cradle to gate").

Green house gas potential: -26 (?) kg CO2 Äqv./m²




For the production of the building materials used, more greenhouse gases were withdrawn from the atmosphere than emitted.

Composition of non-renewable primary energy of production:

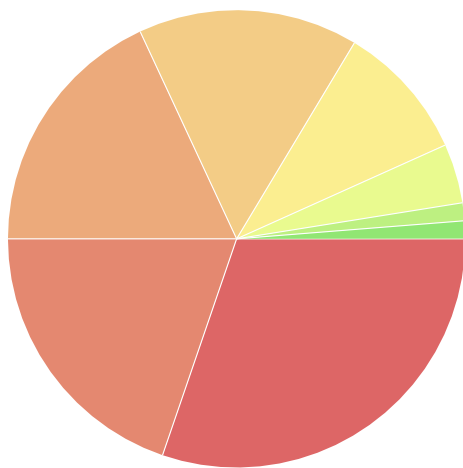

- Szélzáró membrán, speciális alátét lemez 30%
- Korcoltlemez burkolt: Steel (0,6 mm) 20%
- Formaldehidmentes OSB/3 (18 mm) 18%
- STEICO/NATURHELD fűt farost szigetelés (300 mm) 16%
- STEICOinstall (50 mm) 10%
- 12,5 mm tűzgátló karton (12,5 mm) 4%
- STEICO GLVL R gerenda (300x39) 1%
- Szellőztetett deszkaburkolat (30x100) 1%


Composition of the greenhouse potential of production:

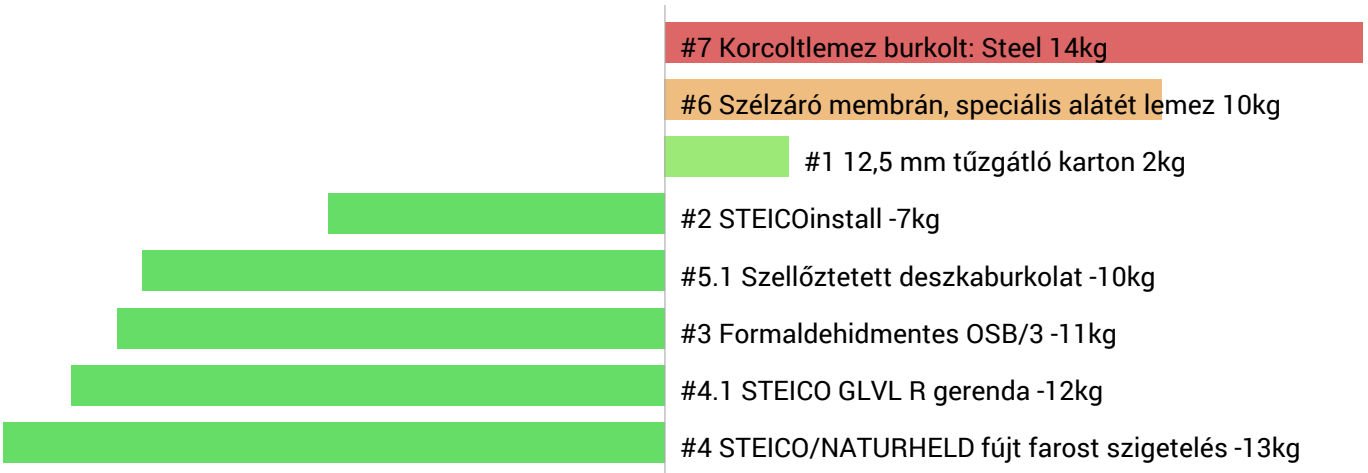

Attention: At least one layer could not be considered because its primary energy content and / or global warming potential is unknown.

A-Frame 202509,  $U=0,11 \text{ W}/(\text{m}^2\text{K})$ 


## Global warming potential and primary energy for construction and use

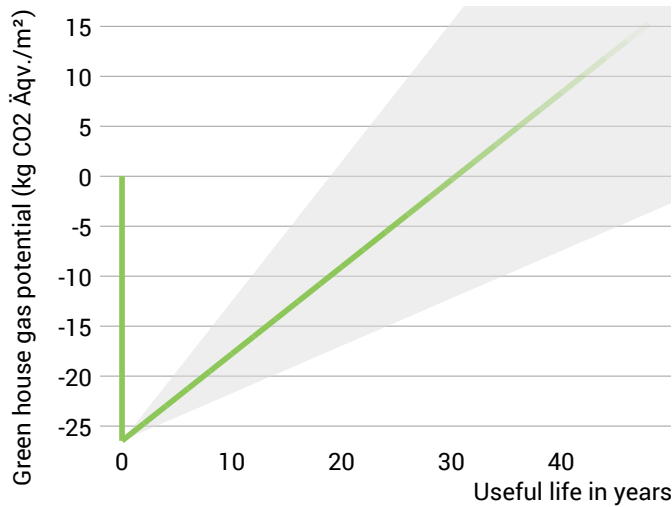

The **left figure** shows the global warming potential of the production of the component in the vertical part of the curve. Greenhouse gas emissions (through heating) arising during use of the building are indicated by the upward curve.

The **figure at the bottom left** shows the non-renewable primary energy expenditure for the production of the component in the vertical part of the curve. The primary energy required during use of the building (through heating) is represented by the upward curve.

The longer the component is used unchanged, the more environmentally friendly it is, because the production costs contribute less to the total emissions (indicated by the color of the curve).

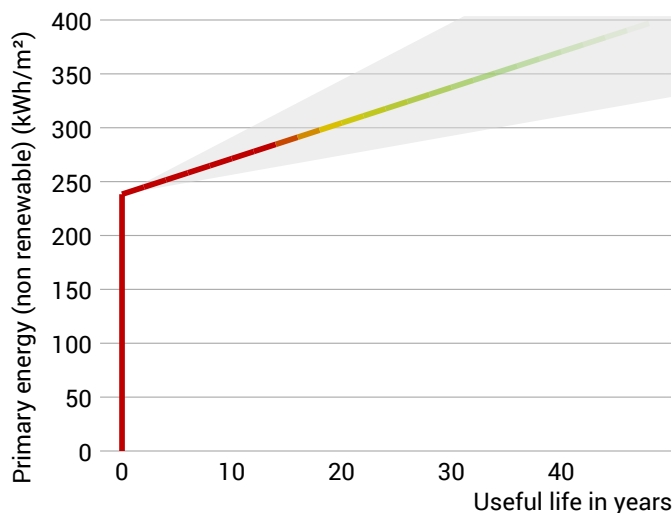

Due to unknown solar and internal gains, the heating demand can only be estimated. Accordingly, primary energy consumption and global warming potential during the use phase are only vaguely known. For the estimation it was assumed that solar and internal profits contribute with  $4 \text{ kWh/a/m}^2$  component area. The light gray area indicates the area in which the curve is located with great certainty. For heat generation, a primary energy input of  $0,50 \text{ kWh}$  per  $\text{kWh}$  of heat and a global warming potential of  $0,13 \text{ kg CO}_2 \text{ eqv/m}^2$  per  $\text{kWh}$  of heat was used. Heat source: Heat pump (soil).

### Hints

Attention: At least one layer could not be considered because its primary energy content and / or global warming potential is unknown.

Calculated for the location Graz, heating period from Mid of October to End of April. The calculation is based on monthly average temperatures. Source: [www.klimadiagramme.de](http://www.klimadiagramme.de)

The climate and energy data on which this calculation is based can, in some cases, show considerable fluctuations and, in individual cases, deviate considerably from the actual value.

Note: The environmental product data for layer 8 (Korcoltlemez burkolt: Steel) is yet unknown.

Note: For layer 8 (Korcoltlemez burkolt: Steel) no environmental product data could be considered because the density of the layer is unknown.

Note: The environmental product data for layer 9 (Korcoltlemez burkolt: Steel) is yet unknown.



Note: For layer 9 (Korcoltlemez burkolt: Steel) no environmental product data could be considered because the density of the layer is unknown.

The calculated amortization periods of primary energy and global warming potential are therefore too low.

Keine Berechnung möglich.

A-Frame 202509,  $U=0,11 \text{ W}/(\text{m}^2\text{K})$ 

## Temperature profile

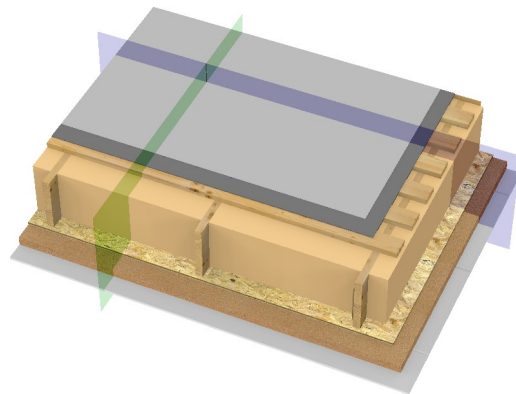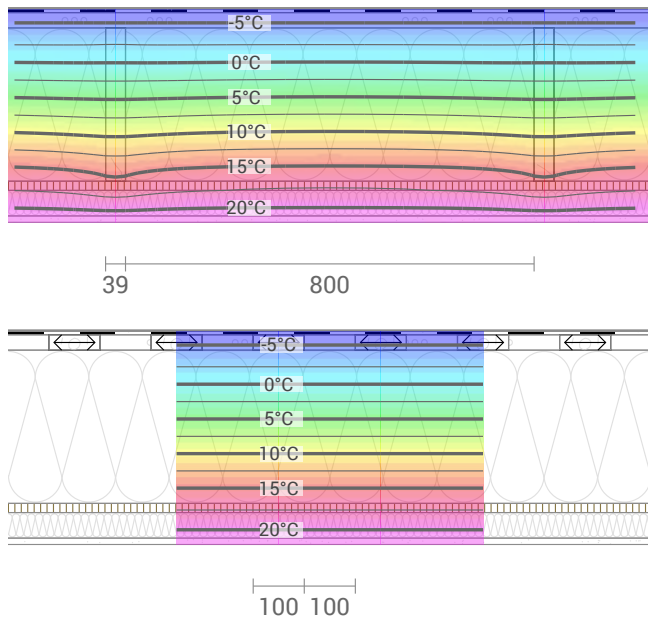

Top left: Temperature profile in the blue section (see right illustration). Bottom left: Temperature profile in the green section.

## Layers (from inside to outside)

| #                        | Material                                        | $\lambda$<br>[W/mK] | R<br>[m <sup>2</sup> K/W] | Temperatur [°C] |      | Weight<br>[kg/m <sup>2</sup> ] |
|--------------------------|-------------------------------------------------|---------------------|---------------------------|-----------------|------|--------------------------------|
|                          |                                                 |                     |                           | min             | max  |                                |
|                          | Thermal contact resistance*                     |                     | 0,250                     | 21,1            | 22,0 |                                |
| 1                        | 1,25 cm 12,5 mm tűzgátló karton                 | 0,250               | 0,050                     | 20,9            | 21,3 | 10,0                           |
| 2                        | 5 cm STEICOinstall                              | 0,040               | 1,250                     | 16,1            | 21,2 | 7,0                            |
| 3                        | 1,8 cm Formaldehidmentes OSB/3                  | 0,130               | 0,138                     | 15,4            | 17,6 | 11,2                           |
| 4                        | 30 cm STEICO/NATURHELD fűjt farost szigetelés   | 0,038               | 7,895                     | -4,9            | 17,2 | 11,4                           |
|                          | 30 cm STEICO GLVL R gerenda (4,6%)              | 0,130               | 2,308                     | -4,7            | 15,6 | 7,7                            |
|                          | Thermal contact resistance*                     |                     | 0,040                     | -5,0            | -4,7 |                                |
| 5                        | 3 cm 30 mm légréssel                            |                     |                           | -5,0            | -5,0 | 0,0                            |
| 6                        | 0,5 cm Szélzáró membrán, speciális alátét lemez |                     |                           | -5,0            | -5,0 | 3,5                            |
| 7                        | 0,06 cm Korcoltlemmez burkolt: Steel            |                     |                           | -5,0            | -5,0 | 4,7                            |
| 7                        | 0,06 cm Korcoltlemmez burkolt: Steel            |                     |                           | -5,0            | -5,0 | 4,7                            |
| 7                        | 0,06 cm Korcoltlemmez burkolt: Steel            |                     |                           | -5,0            | -5,0 | 4,7                            |
| 41,61 cm Whole component |                                                 |                     | 8,840                     |                 |      | 62,2                           |

\*Thermal contact resistances according to DIN 4108-3 for moisture protection and temperature profile. The values for the U-value calculation can be found on the page 'U-value calculation'.

Surface temperature inside (min / average / max): 21,1°C 21,2°C 21,3°C  
 Surface temperature outside (min / average / max): -4,9°C -4,9°C -4,7°C

A-Frame 202509, U=0,11 W/(m²K)

## Moisture proofing

For the calculation of the amount of condensation water, the component was exposed to the following constant climate for 90 days: inside: 22.01 °C und 50% Humidity; outside: -5°C und 70% Humidity (Climate according to user input).

This component is free of condensate under the given climate conditions.

Drying reserve according to Ubakus 2D-FE method: 1018 g/(m²a)


At least required by DIN 68800-2: 250 g/(m²a)

| # | Material                                      | sd-value<br>[m] | Condensate<br>[kg/m²]<br>[Gew.-%] | Weight<br>[kg/m²] |
|---|-----------------------------------------------|-----------------|-----------------------------------|-------------------|
| 1 | 1,25 cm 12,5 mm tűzgátló karton               | 0,05            | -                                 | 10,0              |
| 2 | 5 cm STEICOinstall                            | 0,15            | -                                 | 7,0               |
| 3 | 1,8 cm Formaldehidmentes OSB/3                | 4,00            | -                                 | 11,2              |
| 4 | 30 cm STEICO/NATURHELD fűjt farost szigetelés | 0,90            | -                                 | 11,4              |
|   | 30 cm STEICO GLVL R gerenda (4,6%)            | 61,50           | -                                 | 7,7               |
|   | 41,61 cm Whole component                      | 5,23            | 0                                 | 62,2              |

## Humidity

The temperature of the inside surface is 21,1 °C leading to a relative humidity on the surface of 53%.Mould formation is not expected under these conditions.

The following figure shows the relative humidity inside the component.

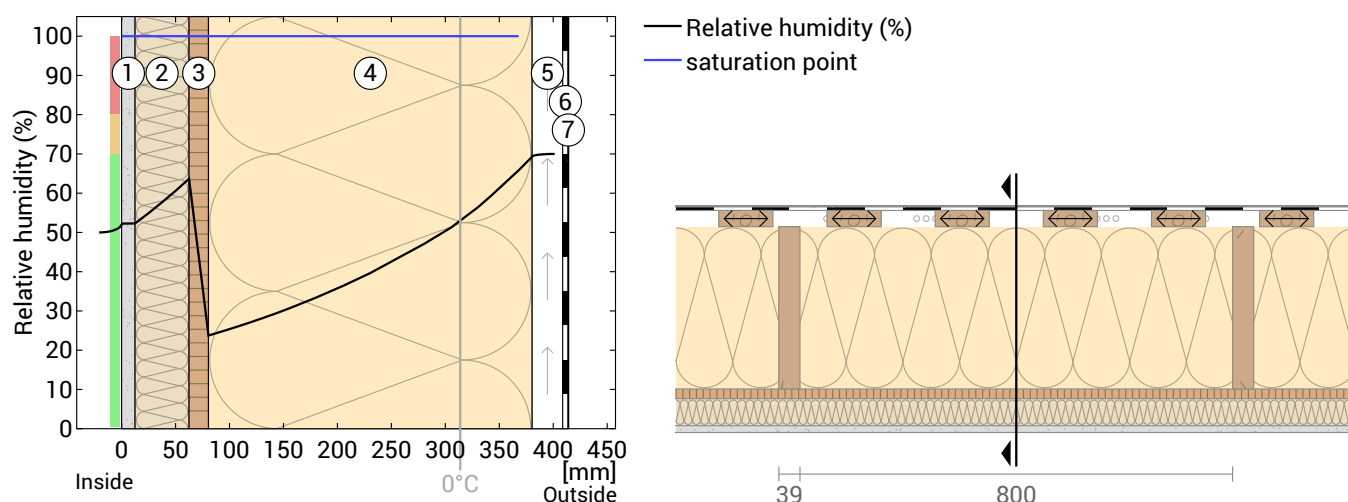

- ① 12,5 mm tűzgátló karton (12,5 mm) ④ STEICO/NATURHELD fűjt farost sz... ⑦ Korcoltlemez burkolt (0,6 mm)  
 ② STEICOinstall (50 mm) ⑤ 30 mm légréssel (30 mm)  
 ③ Formaldehidmentes OSB/3 (18 mm) ⑥ Szélzáró membrán, speciális alátét...

Layers marked with <-> run parallel to the illustrated cutting plane and were not taken into account in the moisture protection calculation.

Notes: Calculation using the Ubakus 2D-FE method. Convection and the capillarity of the building materials were not considered. The drying time may take longer under unfavorable conditions (shading, damp / cool summers) than calculated here.

A-Frame 202509,  $U=0,11 \text{ W/(m}^2\text{K)}$



## Moisture protection in accordance with DIN 4108-3:2024 Appendix A

The temperatures and / or humidities you specify are not in accordance with DIN 4108-3. The following values are given by DIN 4108-3: 20°C / 50% humidity inside and -5°C / 80% humidity outside. Change the values in the input form to enable the calculation according to DIN 4108-3.

A-Frame 202509,  $U=0,11 \text{ W/(m}^2\text{K)}$ 

## Heat protection

The following results are properties of the tested component alone and do not make any statement about the heat protection of the entire room:

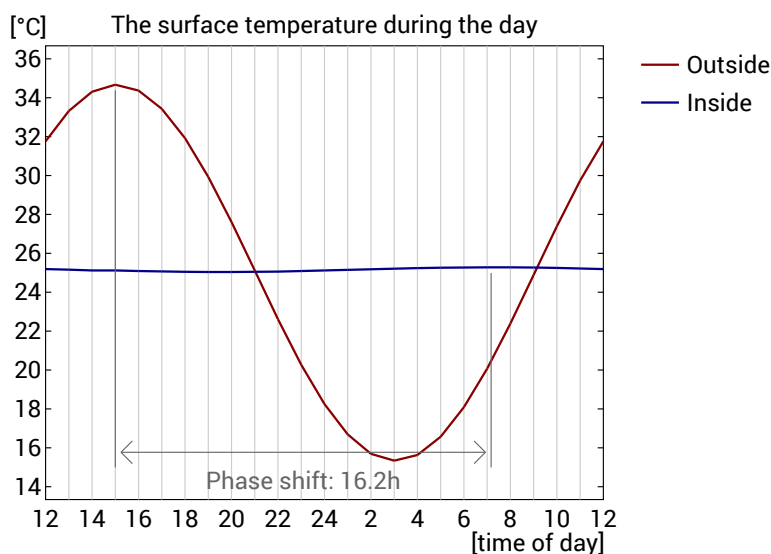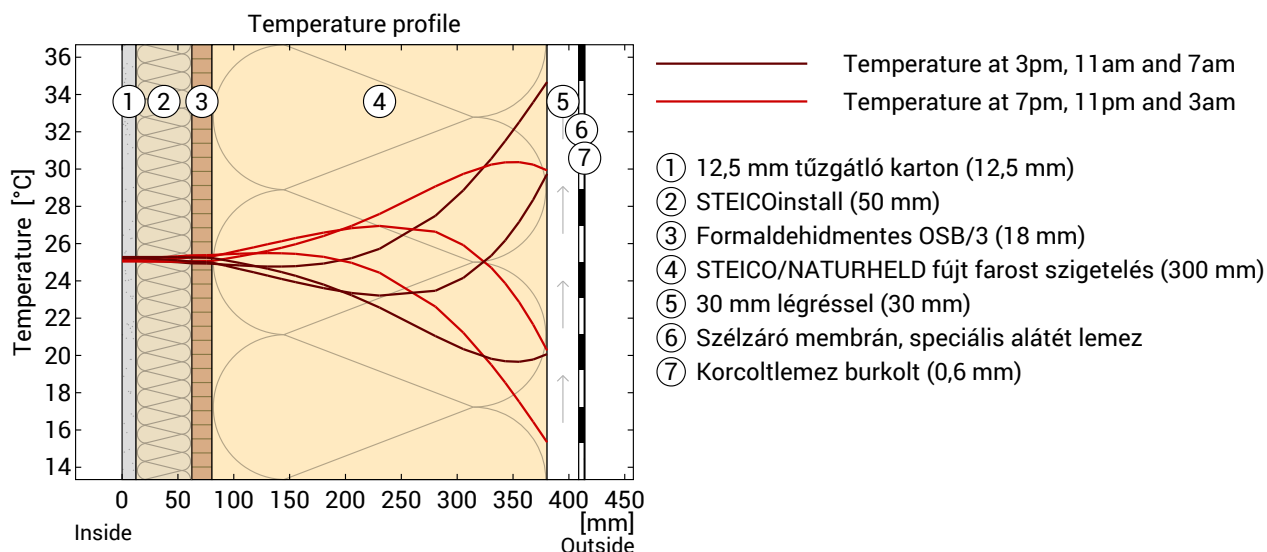

**Top:** Temperature profile within the component at different times. From top to bottom, brown lines: at 3 pm, 11 am and 7 am and red lines at 7 pm, 11 pm and 3 am.

**Bottom:** Temperature on the outer ( red ) and inner ( blue ) surface in the course of a day. The arrows indicate the location of the temperature maximum values . The maximum of the inner surface temperature should preferably occur during the second half of the night.

|                          |        |                                          |                        |
|--------------------------|--------|------------------------------------------|------------------------|
| Phase shift*             | 16,2 h | Heat storage capacity (whole component): | 80 kJ/m <sup>2</sup> K |
| Amplitude attenuation ** | 80,0   | Thermal capacity of inner layers:        | 54 kJ/m <sup>2</sup> K |
| TAV ***                  | 0,013  |                                          |                        |

\* The phase shift is the time in hours after which the temperature peak of the afternoon reaches the component interior.

\*\* The amplitude attenuation describes the attenuation of the temperature wave when passing through the component. A value of 10 means that the temperature on the outside varies 10x stronger than on the inside, e.g. outside 15-35 °C, inside 24-26 °C.

\*\*\* The temperature amplitude ratio TAV is the reciprocal of the attenuation:  $TAV = 1 / \text{amplitude attenuation}$

Note: The heat protection of a room is influenced by several factors, but essentially by the direct solar radiation through windows and the total amount of heat storage capacity (including floor, interior walls and furniture). A single component usually has only a very small influence on the heat protection of the room.

The calculations presented above have been created for a 1-dimensional cross-section of the component.

A-Frame 202509,  $U=0,11 \text{ W/(m}^2\text{K)}$

## Hints

### Mindestwärmeschutz nach DIN 4108-2

Der Höchstwert  $U < 0.51 \text{ W/m}^2\text{K}$  gilt nur für homogene Bauteile ohne Abdichtungen. Daneben gilt gemäß Absatz 5.1.3 die folgende Anforderung:

"Bei thermisch inhomogenen Bauteilen, wie sie beispielsweise bei Skelett-, Rahmen- oder Holzständerbauweisen, aber auch bei Fassaden als Pfosten-Riegel-Konstruktion vorkommen, ist im Bereich des Gefachs ein Wärmedurchlasswiderstand  $R_G \geq 1,75 \text{ m}^2\text{K/W}$  einzuhalten. Zusätzlich gilt für das gesamte Bauteil im Mittel ein Anforderungswert von  $R_m \geq 1,0 \text{ m}^2\text{K/W}$ ."

Für Umkehrdächer und Perimeterdämmungen beschreibt Absatz 5.2.2 zusätzliche Anforderungen.

Die Einhaltung dieser Anforderungen (falls zutreffend) ist vom verantwortlichen Planer zu prüfen.

### Rear ventilation level

The thickness of the rear ventilation level is 3 cm. Generally, the thickness should be at least 3 cm. If the inclination of the rear ventilation plane is less than  $40^\circ$ , e.g. for (flat) roofs, a larger value must be selected. The same applies if the air inlet and the air outlet are particularly far apart.

The part of your component that is relevant to the calculation ends at the inside of the rear ventilation level. Outlying layers do not need to be entered.

Beams and joists which penetrate the rear ventilation level are only considered up to the inside of the rear ventilation level.

Please note: The U-value calculator basically assumes that a rear ventilation level is adequately permeated by outside air. Whether this is actually the case depends not only on the thickness of the rear ventilation level, but also on their width and length and possible obstacles in the air inlet and outlet and can not be assessed by the U-value calculator.