


240 mm JOIST + 60 mm + vakolattal - 202601

Exterior wall
created on 17.1.2026

HempWood falszerkezet

Thermal protection

$$U = 0,11 \text{ W}/(\text{m}^2\text{K})$$

DIN 4108*: $R > 1,75 \text{ m}^2\text{K}/\text{W} + R_{\text{si}} + R_{\text{se}}$

 excellent insufficient



Moisture proofing

Drying reserve: 1984 g/m²a
No condensate

 excellent insufficient

Heat protection

Temperature amplitude damping: 95
phase shift: 17,8 h
Thermal capacity inside: 56 kJ/m²K

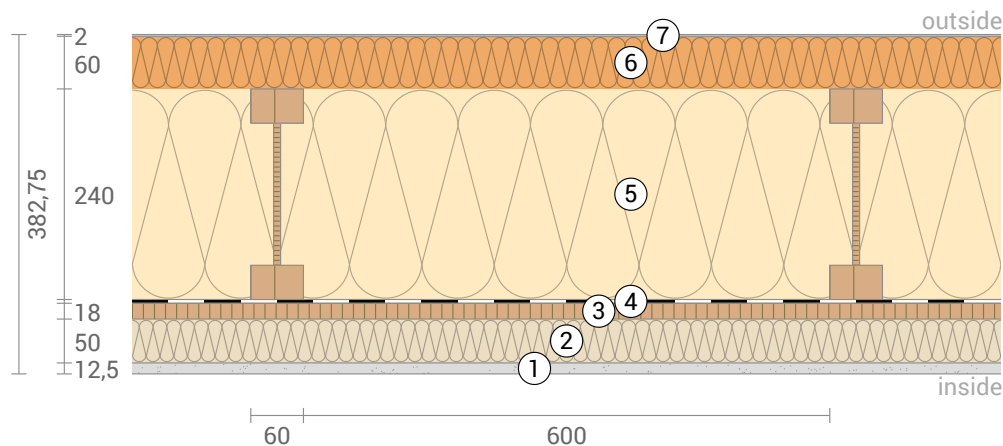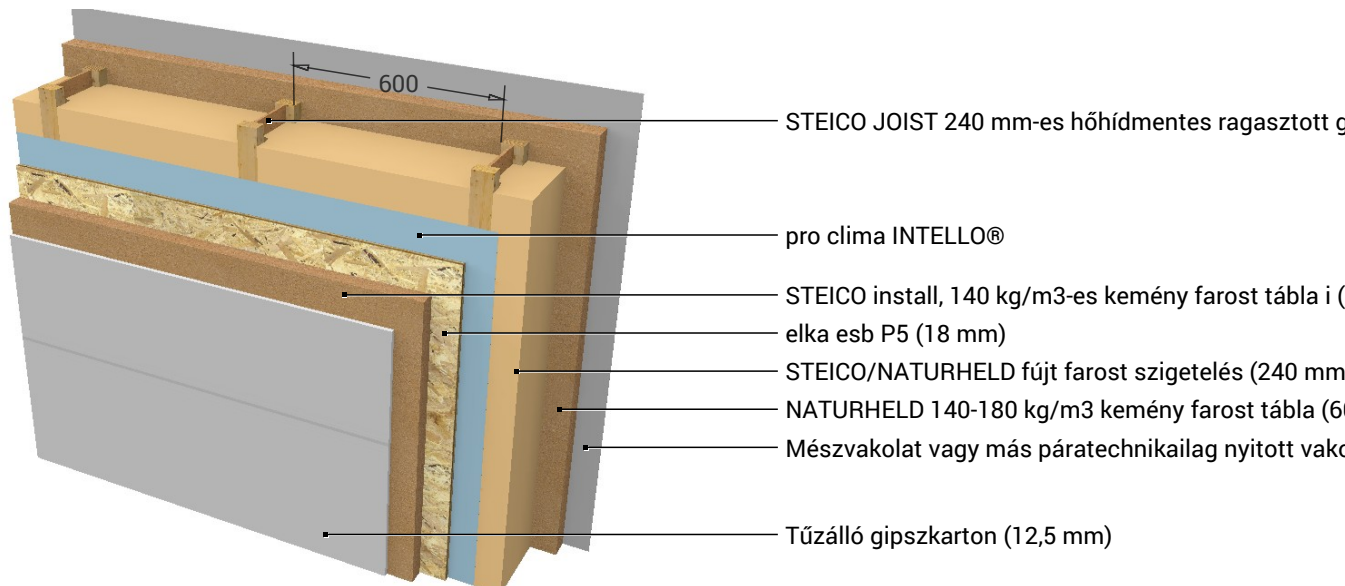 excellent insufficient


- | | |
|---|---|
| ① Tűzálló gipszkarton (12,5 mm) | ⑤ STEICO/NATURHELD fűjt farost szigetelés (240 mm) |
| ② STEICO install, 140 kg/m ³ -es kemény farost tábla i (50 mm) | ⑥ NATURHELD 140-180 kg/m ³ kemény farost tábla (60 mm) |
| ③ elka esb P5 (18 mm) | ⑦ Mészvakolat vagy más páratechnikailag nyitott vako (2 mm) |
| ④ pro clima INTELLO® | |

Inside air : 22,0°C / 50%

Outside air: -5,0°C / 80%

Surface temperature.: 21,2°C / -4,9°C

sd-value: 9,3 m

Thickness: 38,3 cm

Weight: 54 kg/m²

Heat capacity: 95 kJ/m²K

☒ BEG Einzelmaßn.☒ GEG 2020/24 Bestand☒ GEG 2023/24 Neubau☒ DIN 4108

240 mm JOIST + 60 mm + vakolattal - 202601, $U=0,11 \text{ W}/(\text{m}^2\text{K})$

U-Value calculation according to DIN EN ISO 6946

#	Material	Dicke [cm]	λ [W/mK]	R [m ² K/W]
	Thermal contact resistance inside (R _{si})			0,130
1	Tűzálló gipszkarton	1,25	0,250	0,050
2	STEICO install, 140 kg/m ³ -es kemény farost tábla i	5,00	0,040	1,250
3	elka esb P5	1,80	0,120	0,150
4	pro clima INTELLO®	0,03	0,040	0,006
5	STEICO/NATURHELD fűjt farost szigetelés	24,00	0,038	6,316
	Hartfasersteg (Width: 0,8 cm)	16,20	0,308	0,526
	Furnierschichtholzgurt (Width: 6 cm)	3,90	0,130	0,300
	Furnierschichtholzgurt (Width: 6 cm)	3,90	0,130	0,300
6	NATURHELD 140-180 kg/m ³ kemény farost tábla	6,00	0,041	1,463
7	Mészvakolat vagy más páratechnikailag nyitott vako	0,20	0,700	0,003
	Thermal contact resistance outside (R _{se})			0,040

Thermal contact resistances have been taken from DIN 6946 Table 7.

R_{si}: heat flow direction horizontally

R_{se}: heat flow direction horizontally, outside: Direct contact to outside air

Upper limit of thermal resistance $R_{\text{tot;upper}} = 9,141 \text{ m}^2\text{K}/\text{W}$.

Lower limit of thermal resistance $R_{\text{tot;lower}} = 8,700 \text{ m}^2\text{K}/\text{W}$.


Check applicability: $R_{\text{tot;upper}} / R_{\text{tot;lower}} = 1,051$ (maximum allowed: 1,5)

The procedure may be used.

Thermal resistance $R_{\text{tot}} = (R_{\text{tot;upper}} + R_{\text{tot;lower}})/2 = 8,920 \text{ m}^2\text{K}/\text{W}$

Estimated maximum relative uncertainty according to section 6.7.2.5: 2,5%

Heat transfer coefficient $U = 1/R_{\text{tot}} = 0,11 \text{ W}/(\text{m}^2\text{K})$

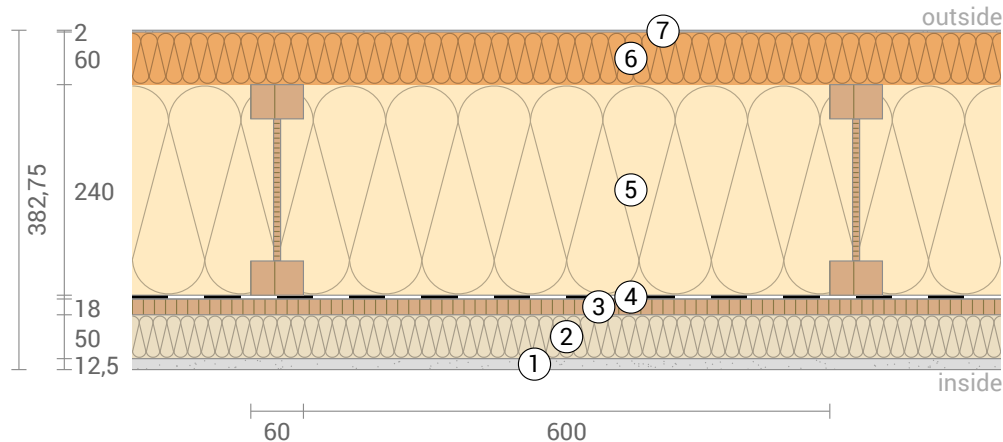

240 mm JOIST + 60 mm + vakolattal - 202601, U=0,11 W/(m²K)


LCA

Heat loss: 10 kWh/m² per heating season




Amount of heat that escapes through one square meter of this component during the heating period. Please note: Due to internal and solar gains, the heating demand is lower than the heat loss.

Primary energy (non renewable): 153 kWh/m²




Non-renewable primary energy (= energy from fossil fuels and nuclear energy) that was used to produce the new building materials ("cradle to gate").

Green house gas potential: -37 kg CO₂ Äqv./m²

For the production of the building materials used, more greenhouse gases were withdrawn from the atmosphere than emitted.

Composition of non-renewable primary energy of production:

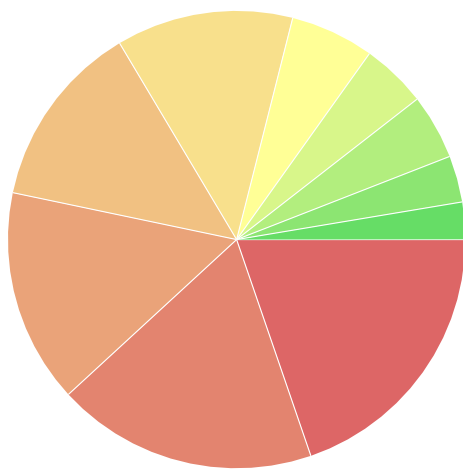

- STEICO/NATURHELD fűtőfarost szigetelés (240 mm) 20%
- NATURHELD 140-180 kg/m³ kemény farost tábla (60 mm) 18%
- STEICO install, 140 kg/m³-es kemény farost tábla i (50 mm) 15%
- Mészvakolat vagy más páratechnikailag nyitott vako (2 mm) 13%
- elka esb P5 (18 mm) 13%
- Tűzálló gipszkarton (12,5 mm) 6%
- Furnierschichtholzgurt (39x60) 5%
- Furnierschichtholzgurt (39x60) 5%
- Hartfasersteg (162x8) 3%
- pro clima INTELLO® 3%

Composition of the greenhouse potential of production:

#7 Mészvakolat vagy más páratechnikailag nyitott vako 4kg



#1 Tűzálló gipszkarton 2kg



#4 pro clima INTELLO® 1kg



#5.1 Hartfasersteg -2kg




#5.2 Furnierschichtholzgurt -2kg




#5.3 Furnierschichtholzgurt -2kg

#2 STEICO install, 140 kg/m³-es kemény farost tábla i -7kg#6 NATURHELD 140-180 kg/m³ kemény farost tábla -8kg

#5 STEICO/NATURHELD fűtőfarost szigetelés -11kg




#3 elka esb P5 -14kg



240 mm JOIST + 60 mm + vakolattal - 202601, $U=0,11 \text{ W}/(\text{m}^2\text{K})$


Global warming potential and primary energy for construction and use

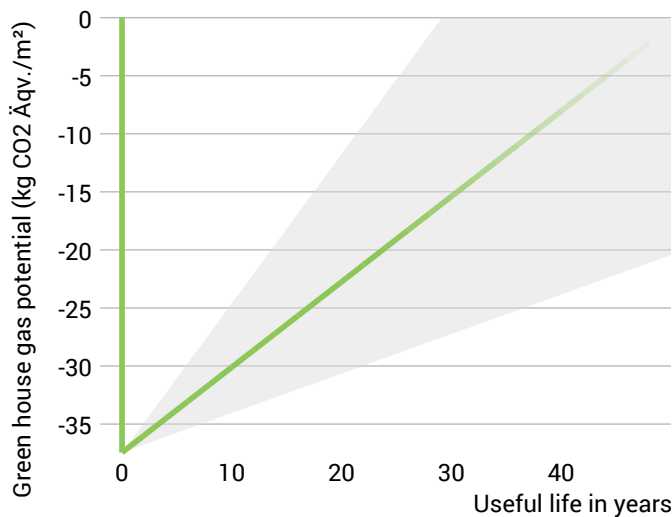

The **left figure** shows the global warming potential of the production of the component in the vertical part of the curve. Greenhouse gas emissions (through heating) arising during use of the building are indicated by the upward curve.

The **figure at the bottom left** shows the non-renewable primary energy expenditure for the production of the component in the vertical part of the curve. The primary energy required during use of the building (through heating) is represented by the upward curve.

The longer the component is used unchanged, the more environmentally friendly it is, because the production costs contribute less to the total emissions (indicated by the color of the curve).

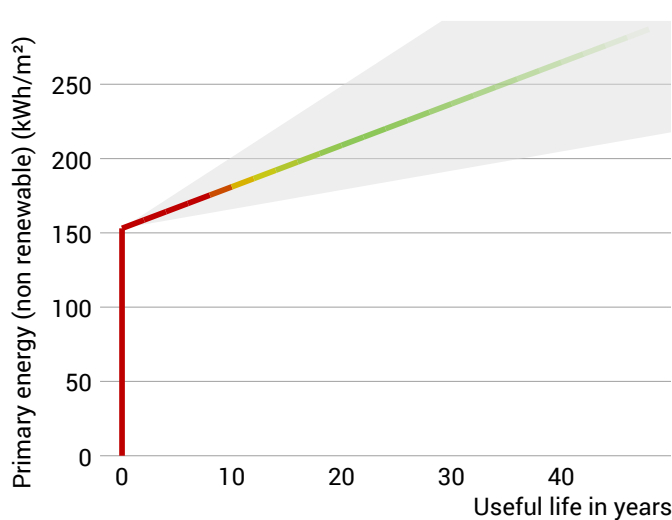

Due to unknown solar and internal gains, the heating demand can only be estimated. Accordingly, primary energy consumption and global warming potential during the use phase are only vaguely known. For the estimation it was assumed that solar and internal profits contribute with 4 kWh/a/m^2 component area. The light gray area indicates the area in which the curve is located with great certainty. For heat generation, a primary energy input of $0,50 \text{ kWh}$ per kWh of heat and a global warming potential of $0,13 \text{ kg CO}_2 \text{ eqv/m}^2$ per kWh of heat was used. Heat source: Heat pump (soil).


Hints

Calculated for the location Wien, heating period from Mid of October to End of April. The calculation is based on monthly average temperatures. Source: Ubakus

The climate and energy data on which this calculation is based can, in some cases, show considerable fluctuations and, in individual cases, deviate considerably from the actual value.

240 mm JOIST + 60 mm + vakolattal - 202601, U=0,11 W/(m²K)

Temperature profile

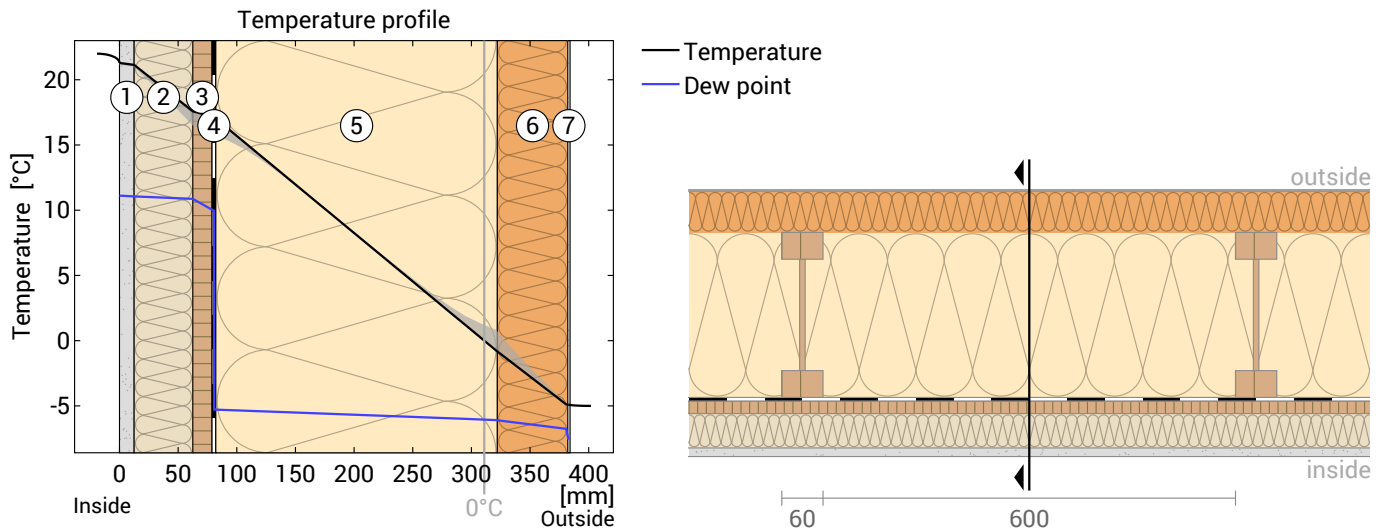

- ① Tűzálló gipszkarton (12,5 mm) ④ pro clima INTELLO® ⑦ Mészvakolat vagy más páratechni...
 ② STEICO install, 140 kg/m³-es kemé... ⑤ STEICO/NATURHELD fűjt farost szí...
 ③ elka esb P5 (18 mm) ⑥ NATURHELD 140-180 kg/m³ kemé...

Left: Temperature and dew-point temperature at the place marked in the right figure. The dew-point indicates the temperature, at which water vapour condensates. As long as the temperature of the component is everywhere above the dew point, no condensation occurs. If the curves have contact, condensation occurs at the corresponding position.

Right: The component, drawn to scale.

Layers (from inside to outside)

#	Material	λ [W/mK]	R [m²K/W]	Temperatur [°C]		Weight [kg/m²]
				min	max	
	Thermal contact resistance*		0,250	21,2	22,0	
1	1,25 cm Tűzálló gipszkarton	0,250	0,050	21,0	21,3	8,5
2	5 cm STEICO install, 140 kg/m ³ -es kemény farost tábla i	0,040	1,250	16,5	21,1	7,0
3	1,8 cm elka esb P5	0,120	0,150	15,8	17,6	11,2
4	0,025 cm pro clima INTELLO®	0,040	0,006	15,8	17,2	0,1
5	24 cm STEICO/NATURHELD fűjt farost szigetelés	0,038	6,316	-0,7	17,1	9,2
	16,2 cm Hartfasersteg (Width: 0,8 cm)	0,308	0,526	2,6	14,0	1,8
	3,9 cm Furnierschichtholzgurt (Width: 6 cm)	0,130	0,300	13,9	16,1	1,8
	3,9 cm Furnierschichtholzgurt (Width: 6 cm)	0,130	0,300	0,7	2,6	1,8
6	6 cm NATURHELD 140-180 kg/m ³ kemény farost tábla	0,041	1,463	-4,9	0,8	8,4
7	0,2 cm Mészvakolat vagy más páratechnikailag nyitott vako	0,700	0,003	-4,9	-4,8	4,0
	Thermal contact resistance*		0,040	-5,0	-4,9	
	38,275 cm Whole component		8,845			53,7

*Thermal contact resistances according to DIN 4108-3 for moisture protection and temperature profile. The values for the U-value calculation can be found on the page 'U-value calculation'.

Surface temperature inside (min / average / max): 21,2°C 21,2°C 21,3°C
 Surface temperature outside (min / average / max): -4,9°C -4,9°C -4,9°C

240 mm JOIST + 60 mm + vakolattal - 202601, U=0,11 W/(m²K)

Moisture proofing

For the calculation of the amount of condensation water, the component was exposed to the following constant climate for 90 days: inside: 22°C und 50% Humidity; outside: -5°C und 80% Humidity (Climate according to user input).

This component is free of condensate under the given climate conditions.


Drying reserve according to Ubakus 2D-FE method: 1984 g/(m²a)
At least required by DIN 68800-2: 100 g/(m²a)

#	Material	sd-value [m]	Condensate [kg/m²] [Gew.-%]	Weight [kg/m²]
1	1,25 cm Tűzálló gipszkarton	0,05	-	8,5
2	5 cm STEICO install, 140 kg/m3-es kemény farost tábla i	0,15	-	7,0
3	1,8 cm elka esb P5	0,72	-	11,2
4	0,025 cm pro clima INTELLO®	7,57	-	0,1
5	24 cm STEICO/NATURHELD fűjt farost szigetelés	0,24	-	9,2
	16,2 cm Hartfasersteg (Width: 0,8 cm)	1,62	-	1,8
	3,9 cm Furnierschichtholzgurt (Width: 6 cm)	0,78	-	1,8
	3,9 cm Furnierschichtholzgurt (Width: 6 cm)	1,95	-	1,8
6	6 cm NATURHELD 140-180 kg/m3 kemény farost tábla	0,18	-	8,4
7	0,2 cm Mészvakolat vagy más páratechnikailag nyitott vako	0,22	-	4,0
38,275 cm Whole component		9,33	0	53,7

Humidity

The temperature of the inside surface is 21,2 °C leading to a relative humidity on the surface of 52%.Mould formation is not expected under these conditions.

The following figure shows the relative humidity inside the component.

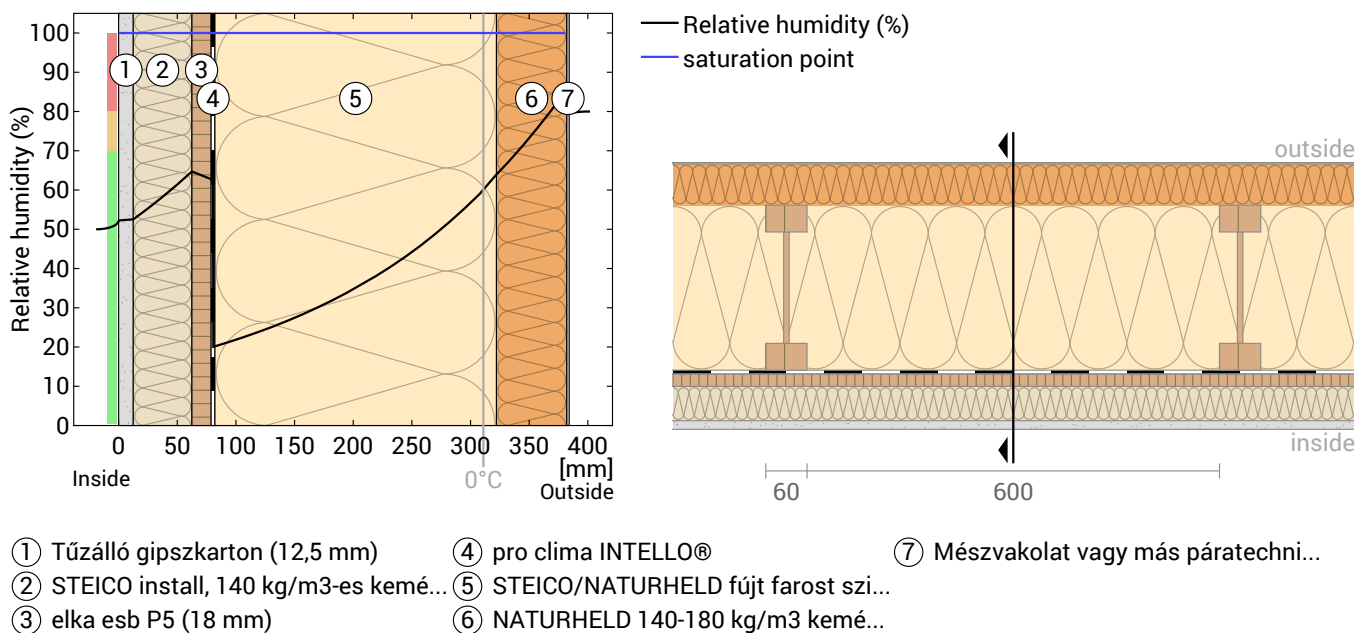

Notes: Calculation using the Ubakus 2D-FE method. Convection and the capillarity of the building materials were not considered. The drying time may take longer under unfavorable conditions (shading, damp / cool summers) than calculated here.

240 mm JOIST + 60 mm + vakolattal - 202601, U=0,11 W/(m²K)



Moisture protection in accordance with DIN 4108-3:2024 Appendix A

The temperatures and / or humidities you specify are not in accordance with DIN 4108-3. The following values are given by DIN 4108-3: 20°C / 50% humidity inside and -5°C / 80% humidity outside. Change the values in the input form to enable the calculation according to DIN 4108-3.

240 mm JOIST + 60 mm + vakolattal - 202601, $U=0,11 \text{ W/(m}^2\text{K)}$

Heat protection

The following results are properties of the tested component alone and do not make any statement about the heat protection of the entire room:

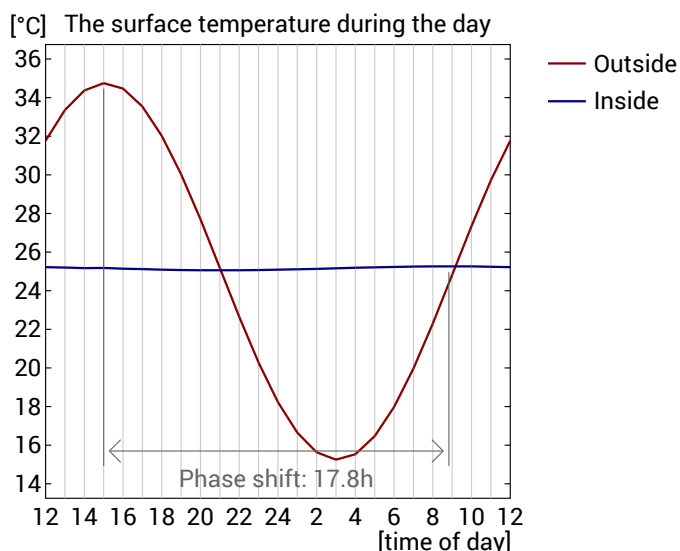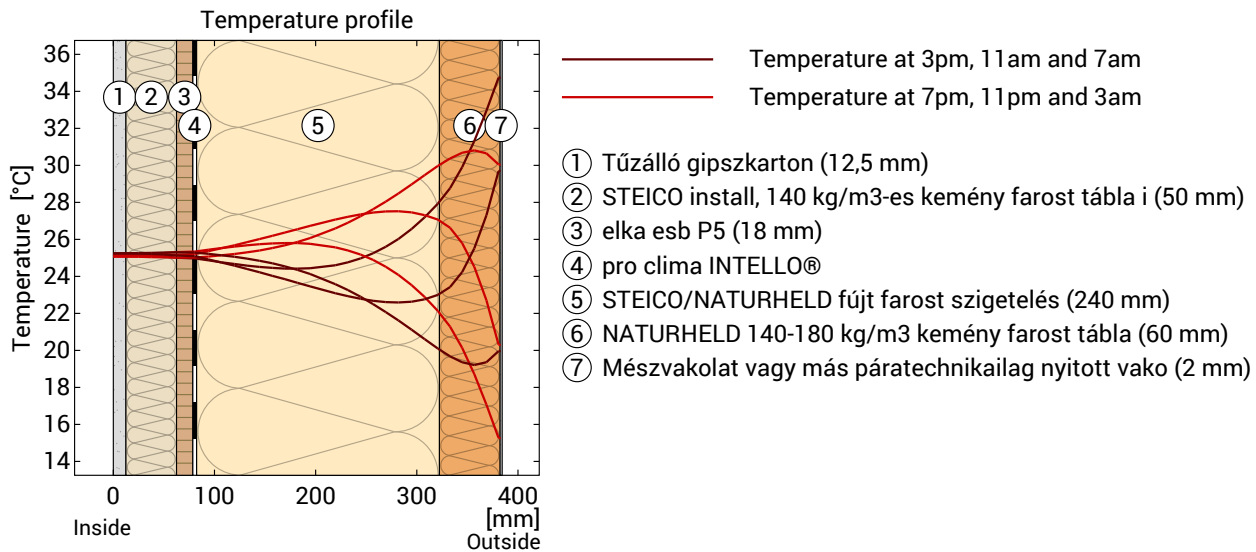

Top: Temperature profile within the component at different times. From top to bottom, brown lines: at 3 pm, 11 am and 7 am and red lines at 7 pm, 11 pm and 3 am.

Bottom: Temperature on the outer (red) and inner (blue) surface in the course of a day. The arrows indicate the location of the temperature maximum values . The maximum of the inner surface temperature should preferably occur during the second half of the night.

Phase shift*	17,8 h	Heat storage capacity (whole component):	95 kJ/m ² K
Amplitude attenuation **	95,2	Thermal capacity of inner layers:	56 kJ/m ² K
TAV ***	0,011		

* The phase shift is the time in hours after which the temperature peak of the afternoon reaches the component interior.

** The amplitude attenuation describes the attenuation of the temperature wave when passing through the component. A value of 10 means that the temperature on the outside varies 10x stronger than on the inside, e.g. outside 15-35 °C, inside 24-26 °C.

*** The temperature amplitude ratio TAV is the reciprocal of the attenuation: $TAV = 1 / \text{amplitude attenuation}$

Note: The heat protection of a room is influenced by several factors, but essentially by the direct solar radiation through windows and the total amount of heat storage capacity (including floor, interior walls and furniture). A single component usually has only a very small influence on the heat protection of the room.

The calculations presented above have been created for a 1-dimensional cross-section of the component.

240 mm JOIST + 60 mm + vakolattal - 202601, $U=0,11 \text{ W/(m}^2\text{K)}$

Hints

Mindestwärmeschutz nach DIN 4108-2

Der Höchstwert $U < 0.52 \text{ W/m}^2\text{K}$ gilt nur für homogene Bauteile ohne Abdichtungen. Daneben gilt gemäß Absatz 5.1.3 die folgende Anforderung:

"Bei thermisch inhomogenen Bauteilen, wie sie beispielsweise bei Skelett-, Rahmen- oder Holzständerbauweisen, aber auch bei Fassaden als Pfosten-Riegel-Konstruktion vorkommen, ist im Bereich des Gefachs ein Wärmedurchlasswiderstand $R_G \geq 1,75 \text{ m}^2\text{K/W}$ einzuhalten. Zusätzlich gilt für das gesamte Bauteil im Mittel ein Anforderungswert von $R_m \geq 1,0 \text{ m}^2\text{K/W}$."

Für Umkehrdächer und Perimeterdämmungen beschreibt Absatz 5.2.2 zusätzliche Anforderungen.

Die Einhaltung dieser Anforderungen (falls zutreffend) ist vom verantwortlichen Planer zu prüfen.